

Serial Transmission Device

TVG Series JA1*

(OPP8-A2D / OPP8-A2D-P)

DeviceNet Compatible

INSTRUCTION MANUAL

SM-A81052-A



- Read this Instruction Manual before using the product.
- Read the safety notes carefully.
- Keep this Instruction Manual in a safe and convenient place for future reference.

PREFACE

Thank you for purchasing CKD's serial transmission device unit. This Instruction Manual contains basic matters such as installation and usage instructions in order to ensure optimal performance of the product. Please read this Instruction Manual thoroughly and use the product properly. Keep this Instruction Manual in a safe place and be careful not to lose it.

Product specifications and appearances presented in this Instruction Manual are subject to change without notice.

- The product, which uses control valves such as solenoid valves, motor valves, and air operated valves, is intended for users who have basic knowledge about materials, fluids, piping, and electricity. CKD shall not be responsible for accidents caused by persons who selected or used the product without knowledge or sufficient training with respect to control valves.
- Since there are a wide variety of customer applications, it is impossible for CKD to be aware of all of them. Depending on the application or usage, the product may not be able to exercise its full performance or an accident may occur due to fluid, piping, or other conditions. It is the responsibility of the customer to check the product specifications and decide how the product shall be used in accordance with the application and usage.

SAFETY INFORMATION

When designing and manufacturing any device incorporating the product, the manufacturer has an obligation to ensure that the device is safe. To that end, make sure that the safety of the machine mechanism of the device, the fluid control circuit, and the electric system that controls such mechanism is ensured.

To ensure the safety of device design and control, observe organization standards, relevant laws and regulations, which include the following:

ISO4414, JIS B8370, JFPS2008 (the latest edition of each standard), the High-Pressure Gas Safety Act, Industrial Safety and Health Act, other safety rules, organization standards relevant laws and regulations.

In order to use our products safely, it is important to select, use, handle, and maintain the products properly. Observe the warnings and precautions described in this Instruction Manual to ensure device safety.

Although various safety measures have been adopted in the product, customer's improper handling may lead to an accident. To avoid this:

Thoroughly read and understand this Instruction Manual before using the product.

To explicitly indicate the severity and likelihood of a potential harm or damage, precautions are classified into three categories: "DANGER", "WARNING", and "CAUTION".

 DANGER	Indicates an imminent hazard. Improper handling will cause death or serious injury to people.
 WARNING	Indicates a potential hazard. Improper handling may cause death or serious injury to people.
 CAUTION	Indicates a potential hazard. Improper handling may cause injury to people or damage to property.

Precautions classified as "CAUTION" may still lead to serious results depending on the situation. All precautions are equally important and must be observed.

Other general precautions and tips on using the product are indicated by the following icon.



Indicates general precautions and tips on using the product.

Precautions on Product Use

WARNING

The product must be handled by a qualified person who has extensive knowledge and experience.

The product is designed and manufactured as a device or part for general industrial machinery.

Use the product within the specifications.

The product must not be used beyond its specifications. In addition, never modify or additionally machine this product.

The product is intended for use in devices or parts for general industrial machinery. It is not intended for use outdoors or in the conditions or environment listed below.

(An exception will be made if the customer consults with CKD prior to use and understands the specifications of the product.

However, even in that case, safety measures must be taken to avoid danger in case of a possible failure.)

- In applications for nuclear power, railroad system, aviation, ship, vehicle, medical equipment, and equipment that directly touches beverage or food.
- For special applications that require safety including amusement equipment, emergency shut-off circuit, press machine, brake circuit, and safety measures.
- For applications where life or properties may be adversely affected, and special safety measures are required.

Do not handle the product or remove pipes and devices until confirming safety.

- Inspect and service the machine and devices after confirming the safety of the entire system. Also, turn off the energy source (air supply or water supply) and power to the relevant facility. Release compressed air from the system and use extreme care to avoid water or electric leakage.
- Since there may be hot or live parts even after operation has stopped, use extreme care when handling the product or removing pipes and devices.
- When starting or restarting a machine or device that incorporates pneumatic components, make sure that a safety measure (such as a pop-out prevention mechanism) is in place and system safety is secured.

CONTENTS

PREFACE	i
SAFETY INFORMATION.....	ii
Precautions on Product Use.....	iii
CONTENTS.....	iv
1. PRODUCT OVERVIEW	1
1.1 System Overview	1
1.1.1 System features	1
1.1.2 System structure	2
1.2 Part Name	3
1.2.1 Parts of the device unit	3
1.2.2 Switches and LED indicators	4
1.3 Specifications	6
1.3.1 Communication specifications	6
1.3.2 Device unit specifications	7
2. INSTALLATION	8
2.1 Mounting	8
2.2 Wiring	9
2.2.1 Connecting and wiring to the Network connectors.....	9
2.2.2 Connecting and wiring to the valve power plug.....	11
3. USAGE.....	12
3.1 Setting the Switches	12
3.1.1 Node address setting.....	13
3.1.2 Other switch settings	13
3.1.3 Software mode.....	13
3.2 Network configuration with EDS (Electric Data Sheet) file	14
3.2.1 Registering the device	14
3.3 Correspondence between the device unit output number and PLC address number	15
3.3.1 PLC address correspondence table	15
3.3.2 Examples of valve number array corresponding to solenoid output number.....	15
3.4 Programming	17
3.4.1 Programming	17
3.4.2 Data mapping.....	17
3.4.3 Device profile	17
3.4.4 Object implementation	18
4. MAINTENANCE AND INSPECTION	21
4.1 Periodic Inspection.....	21
4.2 Removing and Mounting.....	22
4.2.1 Removing the product (Device unit)	23
4.2.2 Mounting the product (Device unit).....	23
5. Troubleshooting.....	24
5.1 Problems, Causes, and Solutions	24
6. WARRANTY PROVISIONS	25
6.1 Warranty Conditions	25
6.2 Warranty period.....	25

1. PRODUCT OVERVIEW

1.1 System Overview

1.1.1 System features



Make sure to read the instruction manual for each product.
This Instruction Manual mainly describes the device unit OPP8-A2D-* (JA1*) for TVG.
For Controller unit and other device units that are connected in the same system as the product, read the instruction manuals issued by each manufacturer.
For manifold solenoid valves, make sure to read both this Instruction Manual and the instruction manual for the solenoid valve to fully understand the functions and performance in order to use the valves correctly.

■ OPP8-A2D-* (JA1*)

OPP8-A2D-* (JA1*) is a device unit for TVG that can be connected to DeviceNet, an open field network defined by ODVA.

Features include the following:

- The device unit is connected to PLC with only a Communication cable (DeviceNet dedicated), allowing significant reduction in wiring man-hours.
- The communication power and the valve power are separated, ensuring easy maintenance.
- When a communication error occurs, the device unit output status can be set by a switch. (Hold all point output/ Clear all points output).
- The device unit is available in +COM or -COM specification.


1.1.2 System structure

This system mainly consists of a PLC, Controller unit, OPP8-A2D-* mounted manifold solenoid valve, and peripheral equipment (DeviceNet devices).

Examples of PLC and Controller unit combination

PLC manufacturer	Compatible PLC	Controller unit model
Omron Corporation	NJ Series	CJ1W-DRM21
	CJ Series	
Rockwell Automation Japan Co., Ltd.	1756-L75	1756-DNB
Other DeviceNet compatible Controller units		


Example of basic structure of the system

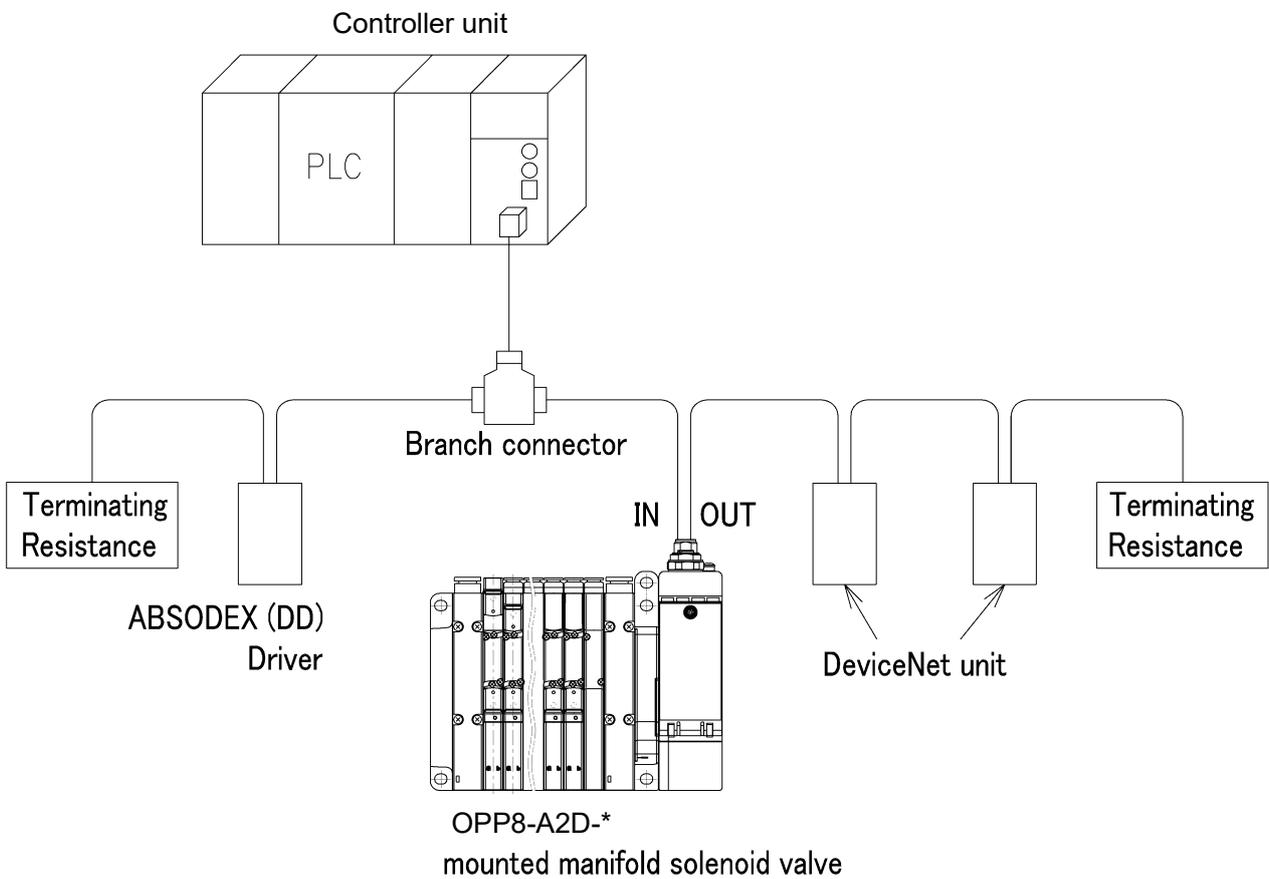

Controller unit: A unit which controls device units and requests to open connection.
 Branch connector: A device which is used for branch connection.

1.2 Part Name

1.2.1 Parts of the device unit

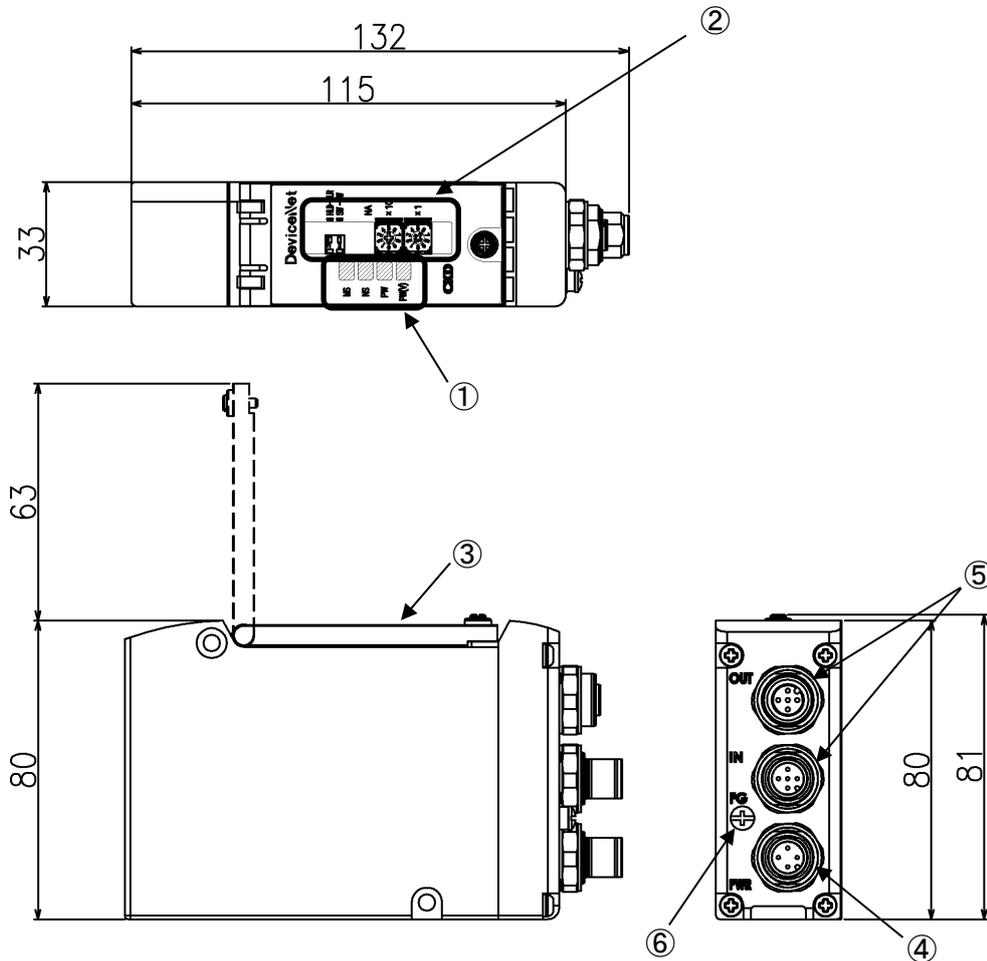


No.	Part name	Description
①	LED indicators	Indicate the status of the device unit and network with MS, NS, PW, and PW(V).
②	Switches	Rotary switches: Set the node address of the device unit. DIP switches: Set the output when a communication error occurs and the operation mode.
③	Cover	Protects the LEDs and setting switches.
④	Valve power plug (M12×1 port【PWR】4-pin, A-cord)	Connects valve power socket (24 V).
⑤	Network connector (M12×2 ports【IN, OUT】5-pin, A-cord)	IN: Input port for DeviceNet communication (plug) OUT: Output port for DeviceNet communication (socket)
⑥	FG terminal	Connects to FG.

1.2.2 Switches and LED indicators

⚠ CAUTION

Discharge static electricity from your body before touching the product.
 Static electricity may cause damage to the product.

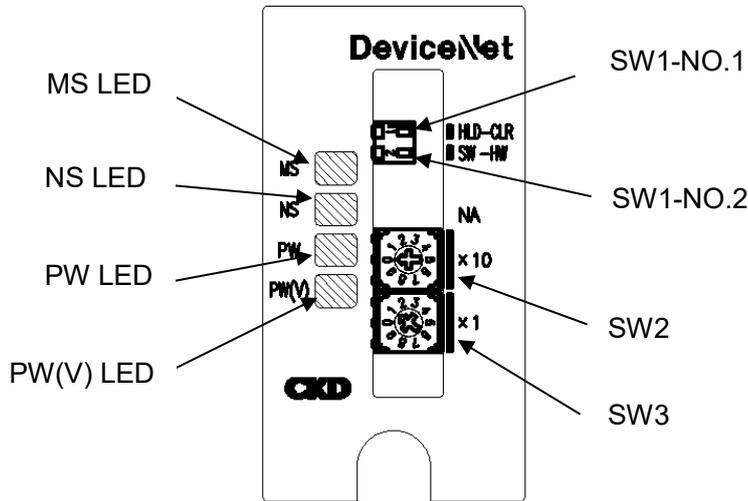

■ Switches

The switches are used to set the device unit operation mode, output mode in the event of a communication error, and node address.

This device unit operates according to the switch settings when the power is turned on.

* Setting changes will not be recognized after the power is turned on.

Marking	Switches	Settings
SW1-NO.1 (DIP switch)	HLD-CLR (Output mode setting)	Selects whether to hold (HLD) or clear (CLR) the output status when a communication error occurs.
SW1-NO.2 (DIP switch)	SW-HW (Operation mode setting)	Selects software mode (SW) or hardware mode (HW) for the operation mode.
SW2, SW3 (Rotary switch)	NA ×10, ×1 (Node address setting)	Sets the device unit node address between 0 to 63. SW2 sets in the tens place and SW3 sets in the ones place.

■ LED indicators

These LEDs indicate the status of the product and network.
Refer to the following table for the description of LED indicators.

1) <Module status (MS) / Network status (NS) LED>

MS LED	NS LED	Indication		Comments
Green ON	Green ON	I/O communication in progress	I/O data is being communicated between the Controller and device unit.	Operating normally.
Green ON	OFF	Node address duplication checking	Waiting for node address duplication checking to be completed at the Controller.	In case only the certain device unit is in this condition, restart the unit after checking if the baud rate is the same as the Controller.
Green ON	Green Flashing	Connection waiting	Waiting for connection establishment from the Controller.	
Red ON	OFF	Watchdog timer error	Watchdog timer error occurred in the device unit.	Replace the device unit.
Red Flashing	Green ON	Switch setting change during I/O communication	The status in which Rotary and DIP switch settings during I/O communication had been changed.	The switch settings had been changed during I/O communication. Red blinking of MS LED will become green (light) by putting back the switch to the former position or restarting and updating the device unit settings.
Red Flashing	OFF	Improper switch setting	Rotary switch setting is not correct.	Restart the device unit after checking the switch setting.
Green ON	Red ON	Duplicate node address	Node address is duplicated.	After re-setting the node address to avoid duplicate, restart the device unit.
Green ON	Red ON	Bus-off detection	Bus-off (communication stop status by multiple data errors)	Check the following and restart the device unit. *Matching Controller and device baud rates *Proper cable lengths (trunk and branch lines) *Broken or loose cables *Installation of terminators at both ends of the trunk line *Excessive noise
Green ON	Red Flashing	Communication time out		
OFF	OFF	No communication power supply		After checking both node address and baud rate are set properly, supply the communication power supply.

2) <POWER LED (PW)>

POWER LED (PW)	Indication
Green ON	Communication power supply is ON.
OFF	Communication power supply is OFF.

3) <VALVE LED (PW (V))>

* Effective when the communication power is ON.

VALVE LED (PW(V))	Indication
Green ON	Valve power supply is ON.
OFF	Valve power supply is OFF.

1.3 Specifications

1.3.1 Communication specifications

Item	Specifications			
Transfer rate (Baud rate)	Auto setting (125 kbps /250 kbps /500 kbps)			
Communication media (Communication cable)	DeviceNet dedicated 5-wire cable signal lines, (2 signal lines, 2 power lines, 1 shielded line)			
Communication distances	Transfer rate (Baud rate)	Network length	Branch line length	Total branch line length
	125kbps	500m max. *1	6m max.	156m max.
	250kbps	250m max. *1	6m max.	78m max.
	500kbps	100m max.	6m max.	39m max.
Communication power supply	11.0 VDC to 25.0 VDC			
Error control method	CRC error check			

*1: These are for thick cables. Keep the maximum length to 100m or less when using thin cables.

1.3.2 Device unit specifications

The product must be used within the following specifications.

Item	Specifications	
Model No.	OPP8-A2D (JA1C)	OPP8-A2D-P (JA1D)
Communication power supply voltage	11.0 VDC to 25.0 VDC	
Communication power supply current consumption	50 mA or less	
Valve power voltage	22.8 VDC to 26.4 VDC (24 VDC +10%, -5%)	
Valve power current consumption	10 mA or less (all points OFF)/15 mA or less (under no load with all points ON)	
Output type	+COM(NPN)	-COM (PNP)
Number of output point	32 output point	
Node address setting	0-63 (Dec)	
Output setting when communication error occurs	Hold (Hold all points output)/ Clear (Clear all points output)	
Insulation resistance	Between external terminals and the case: 30 MΩ or more with 500 VDC	
Withstand voltage	Between external terminals and the case: 500 VAC for one minute	
Shock resistance	294.0 m/s ² for 3 times in 3 directions	
Storage ambient temperature	-20°C to 70°C	
Storage humidity	30% to 85% RH (no dew condensation)	
Ambient temperature	-5°C to 55°C	
Ambient humidity	30% to 85% RH (no dew condensation)	
Atmosphere	No corrosive gas	
Communication protocol	DeviceNet compliant	
Transfer rate (Baud rate)	Auto setting (125 kbps /250 kbps /500 kbps)	
DeviceNet connector	M12 5-pin A code	
Output insulation	Photo coupler insulation	
Max. load current	40 mA/1 point	
Leakage current	0.1 mA or less	
Residual voltage	0.5 V or less	
Fuse	Communication power supply: 24V, 2A / Valve power supply 24 V, 3 A (Both fuses are non-replaceable)	
Operation indicator	LED (communication status, communication power supply and valve power supply *1)	
Degree of protection	IP65 / IP67	
Number of Byte	4 Byte	
Vibration resistance	Durability	10 Hz to 55 Hz to 10 Hz, 1 octave/min., 15 sweeps each in X, Y, Z directions with 0.75 mm half-amplitude or 98.0 m/s ² , whichever smaller.
	Malfunction	10 Hz to 55 Hz to 10 Hz, 1 octave/min., 4 sweeps each in X, Y, Z directions with 0.5 mm half-amplitude or 68.6 m/s ² , whichever smaller.

*1 Power status can be monitored only when the voltage within the specified range is supplied to communication power supply.

2. INSTALLATION

2.1 Mounting

CAUTION

Before handling a DeviceNet device, touch a grounded metal part to discharge static electricity from your body.

Static electricity may cause damage to the product.

Do not apply tension or shocks to the power cable or Communication cable.

If the wiring is long, the cable weight or shocks may cause an unexpected force and result in damage to the connector or device.

Take appropriate measures such as secure the wiring to the machine or device midway.

To prevent noise problems, keep the following in mind when wiring:

- If noise could have an effect, prepare power for each manifold solenoid valve and wire separately.
- Wire the power cable as short as possible.
- Wire the power cables for the product separately from the power cables for noise-generating devices such as inverter motors.
- Wire the power cable and Communication cable away from other power lines as much as possible.

Wire the power cable and Communication cable properly within its specifications.

Incorrect wiring may cause the device unit to malfunction or break.

Check that cables and connectors are securely connected before turning on the power.

- 1** Connect the Communication cable and power cable.
Check all this Instruction Manual, the instruction manuals for PLC and each unit, and connect the cable properly.
Incorrect connection may cause not only a system failure but also serious fault to the other devices.
- 2** Keep 200 mm or more away from high-voltage lines and power lines or wire the high-voltage lines and power lines in metal tubing and ground it before mounting this device unit.

2.2 Wiring

2.2.1 Connecting and wiring to the Network connectors

WARNING

Turn off the power before wiring.

An electric shock may occur by touching the electrical wiring connection (bare live part).

Do not touch live parts with bare hands.

An electric shock may occur.

Thoroughly read and understand this instruction manual before working on electrical wiring.

CAUTION

Check the working voltage and polarity before wiring and energizing.

Take measures against lightning surges on the device side.

The product has no resistance to lightning surges.

Use a dedicated Communication cable that complies with DeviceNet specifications.

Provide sufficient bending radius for the Communication cable and do not bend it forcibly.

Separate the Communication cable from power lines and high-voltage lines.

Although the DeviceNet uses a dedicated DeviceNet communication cable.

Always understand their specifications thoroughly before wiring.

For details, refer to the instruction manual of the Controller unit manufacturer or ODVA.

The M12 connector for Communication cable is not supplied with this product. Separately purchase a Network connector that satisfies the specifications.

Wiring the Communication cable enables the connector to connect to the Network connector on the device unit.

Recommended Communication cable: DeviceNet dedicated cable

Model	Part name	Manufacturer
DCA2-5CN series	DeviceNet Compatible cable	Omron Corporation

Recommended M12 assembly type connector: A code 5Pin


Model	Part name	Manufacturer
2103 319 1501	M12 assembly type connector (male)	HARTING Co., Ltd.
2103 319 2501	M12 assembly type connector (female)	HARTING Co., Ltd.

■ Connecting the Communication cable


Follow the steps below to connect the Communication cable to the Network connector.

- 1 After confirming safety, stop network communication and turn off all peripheral equipment.
- 2 Refer to the figure below and connect the DeviceNet compliant cable to M12 connector.


IN side

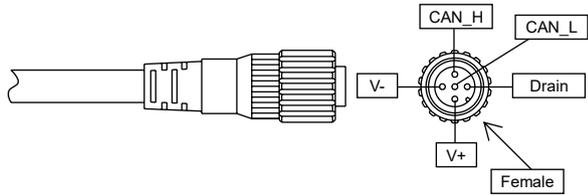

OUT side

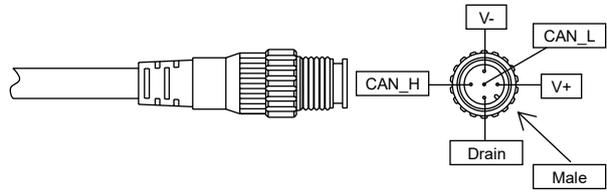

Pin	Signal (): Cable color	Function
1	Drain (none / bare wire)	Connect to the Communication cable "Drain" of the Controller unit or other devices.
2	V+ (red)	Use 11 VDC to 25 VDC power with the least noise.
3	V- (black)	Use 11 VDC to 25 VDC power with the least noise.
4	CAN_H (white)	Connect to the Communication cable "CAN_H" of the Controller unit or other devices.
5	CAN_L (blue)	Connect to the Communication cable "CAN_L" of the Controller unit or other devices.

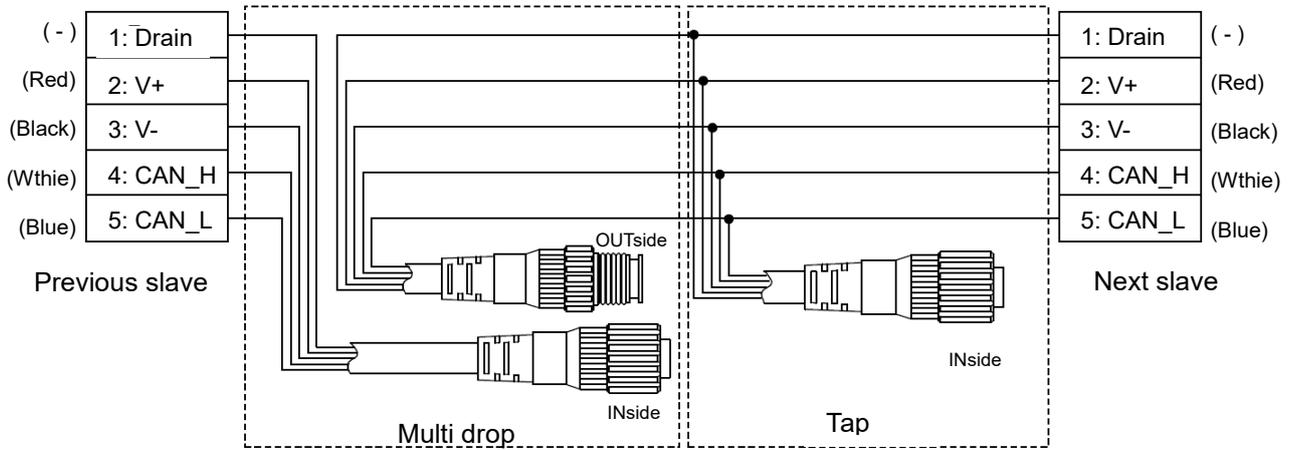

2.2.2 Connecting and wiring to the valve power plug

⚠ CAUTION

Always check the polarity and rated voltage thoroughly before connecting cables.
 Calculate the current consumption to select the power cable.
 Consider the voltage drop due to cables when selecting and wiring the cables if power is supplied to more than one device unit from one power supply.
 Take measures to secure the specified power supply voltage if voltage drop cannot be avoided.

For example, wire the power cables in multiple systems or install other power supplies to secure the specified power supply voltage.

Use a terminal block when crossover wiring power cables.
 Install so that the terminal block is in front of the power plug.

Valve power

This electrical power is for operating the solenoid valve. Use 22.8 VDC to 26.4 VDC power with the least noise.

Recommended M12 unterminated type power cable

Part name	Model	Manufacturer
M12 power cable	XS2F-D421-*8*-*	Omron Corporation

* differs depending on the cable specifications.

Recommended M12 connector


Part name	Model	Manufacturer
Assembly type M12 connector	21 03 212 2305	HARTING

Cable size: AWG22 to 18, outside diameter of compatible cable: 6 to 8 dia.

■ Connecting the power cables

Follow the steps below to connect the valve power cables to the power plug.

- 1 After confirming safety, turn off the power to be connected to the device unit.
- 2 Refer to the figure below and wire the cables to the correct terminals on the power socket (24 V to 24 V, 0 V to 0 V).

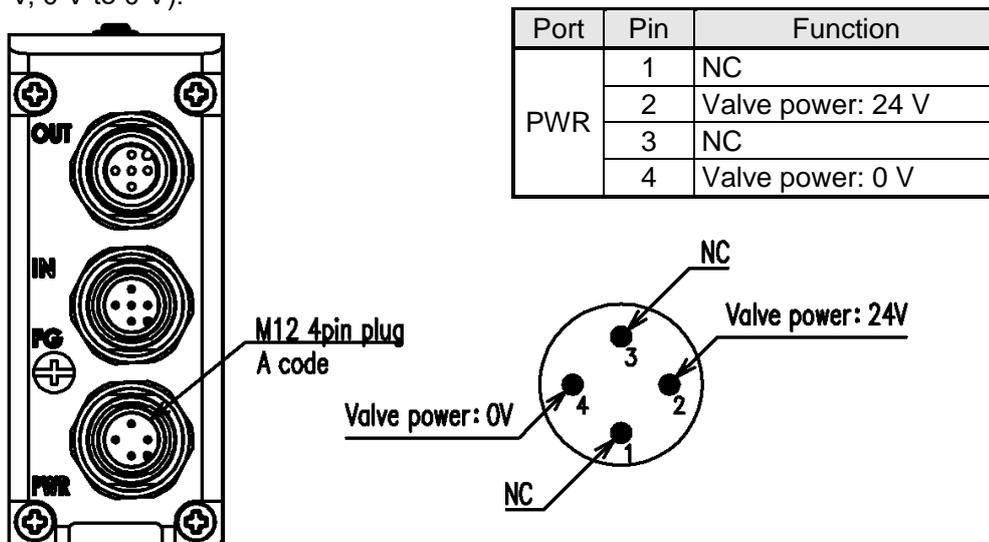

■ Wiring the power cable

Wire 24 VDC to pins 2 and 4 of the power plugs.

* Pins 1 and 3 are not used.

3. USAGE

WARNING

Consult CKD about the specifications before using the product under conditions not specified for the product or for special applications.

CAUTION

Thoroughly read and understand the instruction manual for the network system to be used before using the serial transmission device unit.

Carefully check the address setting value of serial transmission device unit before use.

Improper address setting value may cause valves or cylinders to malfunction.

Be careful of the surroundings and ensure safety before turning on or off the power.

The system or solenoid valve (cylinder) may operate suddenly.

3.1 Setting the Switches

CAUTION

Discharge static electricity from your body before touching the product.

Static electricity may cause damage to the product.

Set switches while communication power is turned off.

Since switch settings are read when the power is turned on, changes made to the settings after turning on the power are not recognized.

Keep the cover of serial transmission device unit closed except when setting the switches.

The cover may become damaged or foreign matters may enter inside and cause unexpected failure.

Be careful not to allow any foreign matter to enter inside when setting the switches.

Unexpected failure may result.

Do not handle switches roughly.

Switches are precision devices and can be easily damaged.

Do not touch the internal circuit board when setting the switches.

The internal circuit board can be easily damaged.

3.1.1 Node address setting

Set the device unit node address.

The device unit functions according to the node address setting at power-up.

(The factory default node address value is 1)

Duplicate node address cannot be assigned.

Switches	Settings
NA. (node address) × 10: Sets tens place digit of the address × 1: Sets ones place digit of the address	0 to 63 (In decimal)

[Example] Node address: 35

3.1.2 Other switch settings

Set output mode and operation mode when communication error occurs.

The setting is read into memory at power-up.

Switches	Settings
HLD-CLR (Output mode setting)	Set the output mode when a communication error occurs. (Such as communication disconnection with PLC or timeout) CLR: Clear mode HOD: Hold mode
SW-HW (Operation mode setting)	Sets the operation mode. HW: Operates in hardware mode SW: Operates in software mode

3.1.3 Software mode

Node address and output mode can be set by software.

However, when setting the node address with software, set the NA switch value to 64 or higher.

* The node address at start-up will be the one that was last established for communication.

The factory default node address value is 1.

Switch settings by software mode

Switches	Description
NA	0 to 63: Switch settings-Enable 64 or more: Switch settings-Disable (software settings-Enable)
HLD-CLR	Switch settings-Disable (software settings-Enable)

3.2 Network configuration with EDS (Electric Data Sheet) file

For the DeviceNet device to join the network, it is necessary to register the communication specification of the device to the network using the EDS file.

Refer to the instruction manual issued by the Controller unit manufacturer for registering the EDS file. Also, use the latest EDS file according to the product version to ensure proper network configuration.

3.2.1 Registering the device

Check the address and Product Name of the device before registering, as both the device and EDS file will need to be matched first.

Refer to the following table for the Product Name and EDS file.

Specifications and the EDS files

Item	Specifications	
Model no.	OPP8-A2D (JA1C)	OPP8-A2D-P (JA1D)
Product Name	OPP8-2D	OPP8-2D-P
Output type	+COM(NPN)	-COM (PNP)
Output points	32 output points	
Name of EDS file	CKD_OPP8_2D_v2101.eds	CKD_OPP8_2D_P_v2101.eds

3.3 Correspondence between the device unit output number and PLC address number

3.3.1 PLC address correspondence table

This correspondence table uses OMRON PLC as an example.

< OPP8-A2D, OPP8-A2D-P (32 points output)>

Assigned address to the PLC memory	Output Bit 00-15															Output Bit 16 to 31																
	00	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Device unit output No.	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32

3.3.2 Examples of valve number array corresponding to solenoid output number


In the table below, each valve number consists of the station number and an alphabet (the a-side solenoid or the b-side solenoid). For example, “1a” refers to 1st station a-side solenoid. Also, “E” stands for “Empty”.

Manifold stations are numbered from left to right with the piping port towards the user (refer to the figure below).

As appearance and maximum number of stations differ depending on the solenoid valve model, check individual specifications.

< OPP8-A2D, OPP8-A2D-P (32 points output)>

The figure below is an example of mounting sixteen stations of double-solenoid type valves. There is no solenoid on the b-side for single-solenoid type.

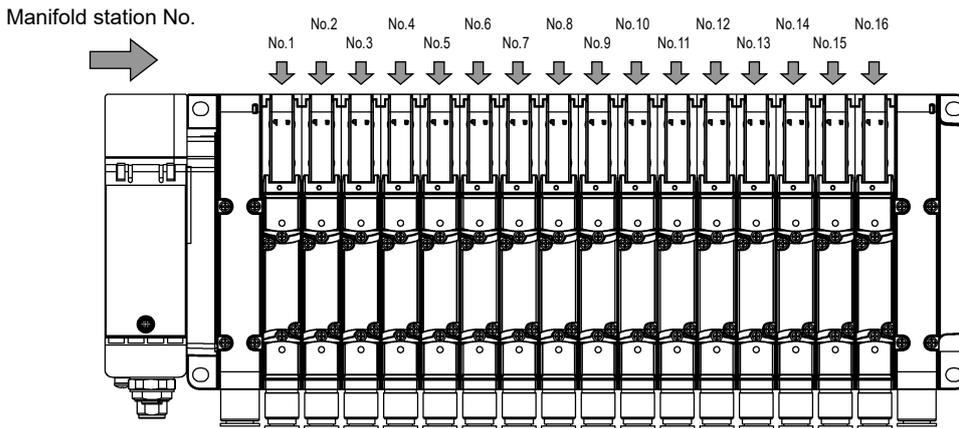

Standard wiring (Double wiring)

- Single solenoid valve

Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16
Valve No	1a	(V)	2a	(V)	3a	(V)	4a	(V)	5a	(V)	6a	(V)	7a	(V)	8a	(V)
Solenoid output No.	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32
Valve No	9a	(V)	10a	(V)	11a	(V)	12a	(V)	13a	(V)	14a	(V)	15a	(V)	16a	(V)

- Double solenoid valve

Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16
Valve No	1a	1b	2a	2b	3a	3b	4a	4b	5a	5b	6a	6b	7a	7b	8a	8b
Solenoid output No.	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32
Valve No	9a	9b	10a	10b	11a	11b	12a	12b	13a	13b	14a	14b	15a	15b	16a	16b

- Mixed (both single and double solenoid valves are mounted) [example]

Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16
Valve No	1a	(V)	2a	(V)	3a	3b	4a	4b	5a	(V)	6a	(V)	7a	7b	8a	(V)
Solenoid output No.	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32
Valve No	9a	(V)	10a	10b	11a	11b	12a	12b	13a	(V)	14a	14b	15a	15b	16a	(V)

Single solenoid, Double solenoid layout specification

- Single solenoid valve

Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16
Valve No.	1a	2a	3a	4a	5a	6a	7a	8a	9a	10a	11a	12a	13a	14a	15a	16a
Solenoid output No.	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32
Valve No	17a	18a	19a	20a	21a	22a	23a	24a	(V)							

- Double solenoid valve

Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16
Valve No	1a	1b	2a	2b	3a	3b	4a	4b	5a	5b	6a	6b	7a	7b	8a	8b
Solenoid output No.	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32
Valve No	9a	9b	10a	10b	11a	11b	12a	12b	13a	13b	14a	14b	15a	15b	16a	16b

- Mixed (both single and double solenoid valves are mounted) [example]

Solenoid output No.	s1	s2	s3	s4	s5	s6	s7	s8	s9	s10	s11	s12	s13	s14	s15	s16
Valve No	1a	2a	3a	3b	4a	4b	5a	6a	7a	7b	8a	9a	10a	10b	11a	11b
Solenoid output No.	s17	s18	s19	s20	s21	s22	s23	s24	s25	s26	s27	s28	s29	s30	s31	s32
Valve No	12a	12b	13a	14a	14b	15a	15b	16a	(V)							

3.4 Programming

3.4.1 Programming

This device unit is treated as a device with 32 points out put: OPP8-A2D-*.

This device unit acts as an output device which transmits output data to valves after receiving it from the controller unit.

Refer to the manual provided by the PLC manufacturer when programing.

Execute the programing by referring to the following table for output data mapping.

The characteristics of this device unit such as output status setting when an error occurs, and the +COM/-COM output specifications, have no relevance to the programming.

3.4.2 Data mapping

Output data mapping

Output points	Output data	Output Bit 00-15															Output Bit 16-31																
		0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
32 points	4bytes	00	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31

3.4.3 Device profile

General device data	Compatible DeviceNet Specifications	Volume One – Edition 3.26 Volume Three – Edition 1.15
	Vendor name	CKD Corporation (ID=0xC9)
	Device type	Pneumatic Valve(s)
Physical conformance data	Communication power supply current consumption	24 VDC 32 output points: 50 mA or less
	Connector style	Sealed micro connector
	Insulation at physical layer	None
	Supported indicators	Module, Network
	MAC ID setting	Rotary switch
	Default MAC ID	1
	Setting baud rate	Auto setting
Supported baud rate	125 kbps/250 kbps/500 kbps	
Communications data	Predefined Controller/ Device connection set	Group 2 Only Server
	Dynamic connections support (UCMM)	None
	Explicit message fragmentation support	Yes

3.4.4 Object implementation

- Identity Object (0x01)

Object class	Attribute	Not supported
	Services	Not supported

Object instance 1 (0x01)	Attribute		ID content	Explicit Message transmission		Value	
	Decimal (Dec)	Hexadecimal (Hex)	-	Get	Set	OPP8-A2D (JA1C)	OPP8-A2D-P (JA1D)
1	0x01	Vender ID	Enable	Disable	201 (0xC9)		
2	0x02	Device Type	Enable	Disable	27(0x1B) Pneumatic Valve(s)		
3	0x03	Product Code	Enable	Disable	87	91	
4	0x04	Revision	Enable	Disable	21.01		
5	0x05	Status	Enable	Disable	bit 0 only		
6	0x06	Serial Number	Enable	Disable	Each Unit		
7	0x07	Product Name	Enable	Disable	OPP8-2D	OPP8-2D-P	
Services	DeviceNet Services		Parameter options				
	0x05	Reset	None				
	0x0E	Get_Attribute_Single	Yes				

- Message Router Object (0x02)

Object class	Attribute	Not supported
	Services	Not supported
Object instance	Attribute	Not supported
	Services	Not supported
Vendor specific additions		None

- DeviceNet object (0x03)

Object class	Attribute		ID content	Explicit Message transmission		Value
	Decimal (Dec)	Hexadecimal (Hex)	-	Get	Set	
1	0x01	Revision	Enable	Disable	2	
Services	DeviceNet Services		Parameter options			
	0x0E	Get_Attribute_Single	Yes			

Object instance 1 (0x01)	Attribute		ID content	Explicit Message transmission	
	Decimal (Dec)	Hexadecimal (Hex)	-	Get	Set
1	0x01	MAC ID	Enable	Enable*1	
2	0x02	Baud rate	Enable	Enable *2	
3	0x03	BOI	Disable	Disable	
4	0x04	Bus-off Counter	Enable	Disable	
5	0x05	Allocation information	Enable	Disable	
6	0x06	MAC ID Switch Changed	Enable	Disable	
8	0x08	MAC ID Switch Value	Enable	Disable	
10	0x0A	Quick Connected	Enable	Enable	
Services	DeviceNet Services		Parameter options		
	0x0E	Get_Attribute_Single	Yes		
	0x10	Set_Attribute_Single	Yes		

* 1 "Set" is enabled only when software mode and NA switch is set to 64 or more (see "3.1.3 Software mode")

* 2 "Set" is enable only at software mode.

● Assembly Object (0x04)

Object class	Attribute		ID content	Explicit Message transmission		Value
	Decimal (Dec)	Hexadecimal (Hex)		Get	Set	
	1	0x01	Revision	Enable	Disable	2
Services	DeviceNet Services		Parameter options			
	0x0E	Get_Attribute_Single	Yes			
	0x10	Set_Attribute_Single	Yes			

Object instance	Attribute		ID content	Explicit Message transmission	
	Decimal (Dec)	Hexadecimal (Hex)		Get	Set
	37 (0x25)	3	0x03	Data	Enable
Services	DeviceNet Services		Parameter options		
	0x0E	Get_Attribute_Single	Yes		
	0x10	Set_Attribute_Single	Yes		

● Connection object (0x05)

Object class	Attribute	Not supported
	Services	Not supported

Object instance	Attribute		ID content	Explicit Message transmission		Value
	Decimal (Dec)	Hexadecimal (Hex)		Get	Set	
	1 (0x01) Explicit	1	0x01	State	Enable	Disable
2		0x02	Instance Type	Enable	Disable	0x00
3		0x03	Transport class trigger	Enable	Disable	0x83
4		0x04	Produced connection ID	Enable	Disable	Each Unit
5		0x05	Consumed connection ID	Enable	Disable	Each Unit
6		0x06	Initial comm characteristics	Enable	Disable	0x21
7		0x07	Produced connection size	Enable	Disable	0x0C00
8		0x08	Consumed connection size	Enable	Disable	0x1300
9		0x09	Expected packed rate	Enable	Enable	0xC409
12		0x0C	Watchdog time-out action	Enable	Disable	1
13		0x0D	Produced connection path length	Enable	Disable	0
15		0x0F	Consumed connection path length	Enable	Disable	0
17		0x11	Production inhibit time	Enable	Disable	0
18		0x12	Connection_timeout_multiplier	Enable	Disable	0
Services		DeviceNet Services		Parameter options		
	0x0E	Get_Attribute_Single	Yes			
	0x10	Set_Attribute_Single	Yes			

	Attribute		ID content	Explicit Message transmission		Value	
	Decimal (Dec)	Hexadecimal (Hex)		Get	Set		
Object instance 2 (0x02) Poll			-	Get	Set		
	1	0x01	State	Enable	Disable	-	
	2	0x02	Instance Type	Enable	Disable	0x01	
	3	0x03	Transport class trigger	Enable	Disable	0x82	
	4	0x04	Produced connection ID	Enable	Disable	Each Unit	
	5	0x05	Consumed connection ID	Enable	Disable	Each Unit	
	6	0x06	Initial comm characteristics	Enable	Disable	0x01	
	7	0x07	Produced connection size	Enable	Disable	0x0000	
	8	0x08	Consumed connection size	Enable	Disable	0x0004	
	9	0x09	Expected packed rate	Enable	Enable	0x0000	
	12	0x0C	Watchdog time-out action	Enable	Enable	0x0000	
	13	0x0D	Produced connection path length	Enable	Disable	0x0000	
	15	0x0F	Consumed Connection path length	Enable	Disable	0x06	
	16	0x10	Consumed connection path	Enable	Disable	20_04_24_25_30_03 (Hex)	
	17	0x11	Production inhibit time	Enable	Disable	0x0000	
	Services	DeviceNet Services			Parameter options		
		0x0E		Get_Attribute_Single	Yes		
0x10			Set_Attribute_Single	Yes			

	Attribute		ID content	Explicit Message transmission		Value	
	Decimal (Dec)	Hexadecimal (Hex)		Get	Set		
Object instance 3 (0x03) Bit Strobed			-	Get	Set		
	1	0x01	State	Enable	Disable	-	
	2	0x02	Instance Type	Enable	Disable	0x01	
	3	0x03	Transport class trigger	Enable	Disable	0x82	
	4	0x04	Produced connection ID	Enable	Disable	Each Unit	
	5	0x05	Consumed connection ID	Enable	Disable	Each Unit	
	6	0x06	Initial comm characteristics	Enable	Disable	0x02	
	7	0x07	Produced connection size	Enable	Disable	0x0000	
	8	0x08	Consumed connection size	Enable	Disable	0x0008	
	9	0x09	Expected packed rate	Enable	Enable	0x0000	
	12	0x0C	Watchdog time-out action	Enable	Enable	0x0000	
	13	0x0D	Produced connection path length	Enable	Disable	0x0000	
	14	0x0E	Consumed connection path	Enable	Disable	-	
	15	0x0F	Consumed Connection path length	Enable	Disable	0x0000	
	17	0x11	Production inhibit time	Enable	Disable	0x0000	
	18	0x12	Connection_timeout_multiplier	Enable	Enable	0x00	
	Services	DeviceNet Services			Parameter options		
		0x0E		Get_Attribute_Single	Yes		
0x10			Set_Attribute_Single	Yes			

● Discrete Output Point Object (0x09)

Object class	Attribute	Not supported
	Services	Not supported

	Attribute		ID content	Explicit Message transmission	
	Decimal (Dec)	Hexadecimal (Hex)		Get	Set
Object instance 1 (0x01) to 32 (0x20)			-	Get	Set
	3	0x03	Value	Enable	Enable
	5	0x05	Fault Action:	Enable	Enable*
	6	0x06	Fault Value	Enable	Enable*
Services	DeviceNet Services			Parameter options	
	0x0E		Get_Attribute_Single	Yes	
	0x10		Set_Attribute_Single	Yes	

* "Set" is enable only at software mode.

4. MAINTENANCE AND INSPECTION

⚠ WARNING

Turn off the power, stop the supply of compressed air and make sure that there is no residual pressure before conducting maintenance.
Do not disassemble, modify, or repair the product.
 These may cause failure or malfunction.

⚠ CAUTION

Plan and perform daily and periodic inspections so that maintenance can be managed properly.
 If maintenance is not properly managed, the product's functions may deteriorate significantly, and this may lead to faults (such as short service life, damage, and malfunction) or accidents.
Do not drop or apply excessive vibrations or shocks to the product.
 These may cause damage because parts inside the product are made to precise specifications.

4.1 Periodic Inspection

This section describes the cleaning and inspection of the device unit for daily maintenance and what to do when replacing the unit. Conduct the periodic cleaning and inspection to use the product in the optimum condition.

■ Cleaning

- 1** For daily cleaning, wipe the product with a soft dry cloth.
- 2** When stains cannot be removed by wiping with a dry cloth, moisten the cloth with diluted neutral detergent (2%), wring it, and wipe the stains again.
- 3** Objects such as rubber, vinyl, or tape may stain the device unit if they are left in contact with the unit for a long period. Remove such objects when cleaning if they are leaving stain on the product.

■ Inspection

Conduct inspection once or twice a year.

If using the product in an environment where temperature or humidity is extremely high or in a dusty environment, conduct inspections at a shorter interval.

<Inspection items>

Inspect the following items to make sure that each item satisfies the criteria.

If any item does not meet the criteria, improve the surrounding environment or adjust the unit.

Inspection items	Inspection details	Criteria	Inspection method
Environment	Is the surrounding and in-panel temperature appropriate?	Refer to "1.3.2 Device unit specifications".	Thermometer
	Is the surrounding and in-panel humidity appropriate?	Refer to "1.3.2 Device unit specifications".	humidity
	Is there any accumulated dust?	No dust	Visual inspection
Installation	Is the device unit fixed securely?	No looseness	Hexagonal wrench
	Is the power cable connector fully inserted?	No looseness	Visual inspection
	Is the Communication cable connector fully inserted?	No looseness	Visual inspection
	Is the connection cable not broken?	No abnormality in appearance	Visual inspection

■ Checking the device unit before/after replacing

Each unit (Controller and device) is a device that constitutes a part of a network. If any unit fails, immediately perform recovery work to prevent the entire network from being affected. To restore the network function as fast as possible, it is recommended to prepare spare units.

<Inspection items>

If a fault is detected and the unit is replaced with a new one, check if the new unit has no abnormality. Also, confirm the device unit settings.

<Settings for replacement device unit>

For the switches on the replacement device unit, confirm the specifications and set the same settings as the previous unit.

4.2 Removing and Mounting

WARNING

Turn off the power and completely release the pressure before removing or adding a manifold solenoid valve.

Thoroughly read and understand this Instruction Manual before removing and adding the manifold solenoid valve.

Do not touch the electrical wiring (bare live part).

An electric shock may occur.

Do not touch live parts with bare hands.

An electric shock may occur.

CAUTION

Check the device unit node address and the setting made to specify which action to take on the output in the event of communication error before turning on the communication power.

Do not attach or detach the connector while the power is turned on.


These may cause failure or malfunction.

Do not pull out the device unit by pulling the cable or connector.

This may cause cable disconnection or damage.

4.2.1 Removing the product (Device unit)

- 1 After confirming safety, stop network communication as necessary and turn off all peripheral equipment.
- 2 After confirming safety, turn off the communication power and valve power as necessary.
- 3 Remove the Network connectors and power socket.
- 4 Loosen the device unit fixing screws.
- 5 Hold and pull out the product slowly in the direction of the arrow.

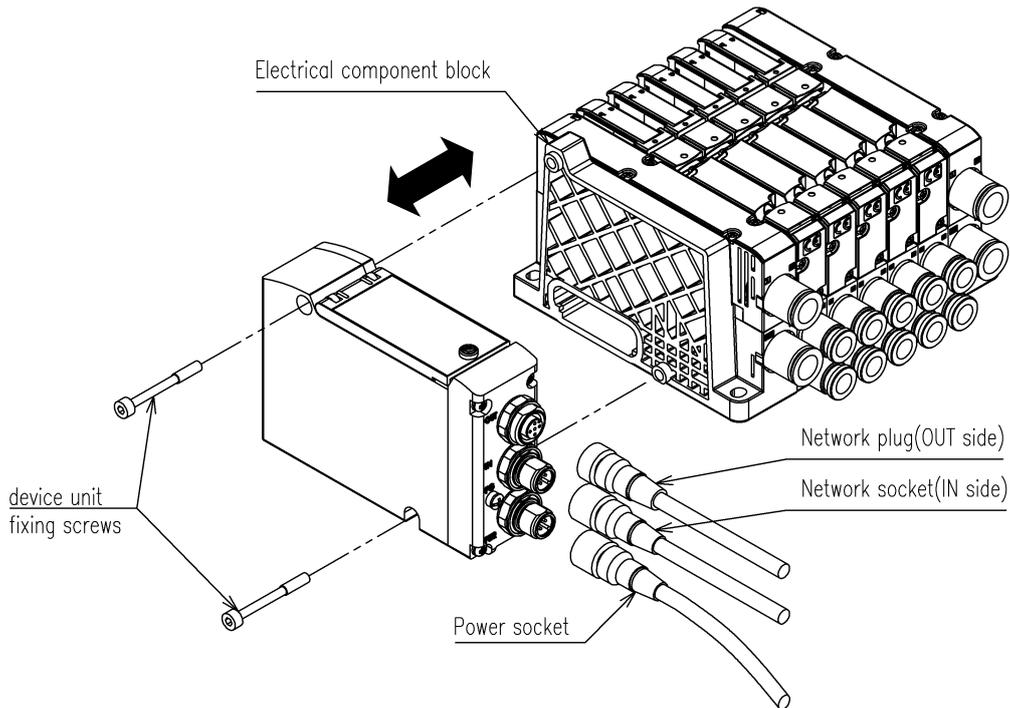

4.2.2 Mounting the product (Device unit)

- 1 Set the node address of the product.
- 2 Hold the unit and insert it slowly by matching connectors of Wiring block and device unit's side surface.
- 3 Make sure that the device unit and the Wiring block are connected and firmly tighten together with the device unit fixing screws.
(Appropriate tightening torque: 1.2 N·m)
- 4 Turn off the power (for communication/valve) and connect the Network connectors and power socket.
The system may operate suddenly if the connectors are installed while the power is turned on. Be careful of the surroundings and secure safety before performing work.
Network connectors: Reference tightening torque is 0.6 N·m
(Since it varies depending on the connector, consult the connector manufacturer.)
Power socket: Reference tightening torque is 0.45 N·m
(Since it varies depending on the connector, consult the connector manufacturer.)
- 5 After confirming safety, turn on each power.

5. Troubleshooting

5.1 Problems, Causes, and Solutions

Troubleshooting for this device unit must be carried out not only for the single unit but for the entire system.

The system may start operating suddenly depending on the communication state. Use extreme care and ensure safety during maintenance.

■ **Fault 1: PW, PW(V) does not light up.**

- Check that the power cable is properly connected and in good condition.
- Check if the supplied power voltage is within the specified range.

■ **Fault 2: MS and NS LEDs are not green (IO communication is not running)**

- Refer to the [1.5 Switches and LED indicators].

■ **Fault 3: Values of NA switches (x 10, x 1) and HC switch are not applied.**

- Power on the switch again after setting.
- Some switch settings become disable in the case of software setting.
(Refer to “3.1.3 Software mode”)

6. WARRANTY PROVISIONS

6.1 Warranty Conditions

■ Warranty coverage

If the product specified herein fails for reasons attributable to CKD within the warranty period specified below, CKD will promptly provide a replacement for the faulty product or a part thereof or repair the faulty product at one of CKD's facilities free of charge.

However, following failures are excluded from this warranty:

- Failure caused by handling or use of the product under conditions and in environments not conforming to those stated in the catalog, the Specifications, or this Instruction Manual.
- Failure caused by use of the product exceeding its durability (cycles, distance, time, etc.) or caused by consumable parts.
- Failure not caused by the product.
- Failure caused by use not intended for the product.
- Failure caused by modifications/alterations or repairs not carried out by CKD.
- Failure caused by reasons unforeseen at the level of technology available at the time of delivery.
- Failure caused by acts of nature and disasters beyond control of CKD.
- Failure caused by incorrect use such as careless handling or improper management.
- Failure that could have been avoided if the customer's machinery or device, into which the product is incorporated, had functions and structures generally provided in the industry.

The warranty stated herein covers only the delivered product itself. Any loss or damage induced by failure of the delivered product is excluded from this warranty.

■ Confirmation of product compatibility

It is the responsibility of the customer to confirm compatibility of the product with any system, machinery, or equipment used by the customer.

■ Others

The terms and conditions of this warranty stipulate basic matters.

When the terms and conditions of the warranty described in individual specification drawings or the Specifications are different from those of this warranty, the specification drawings or the Specifications shall have a higher priority.

6.2 Warranty period

The product is warranted for one year from the date of delivery to the location specified by the customer.