

Handling Precautions

Remote I/O RT series

PROFINET compatible device unit

RT-XTEPN00N

Thank you for purchasing CKD product. Please review the precautions in this Handling Precautions thoroughly for safe operation of this product. Incorrect usage may result in malfunction and dangers. Keep this Precautions in a safe and convenient place for future reference. For further information, refer to the instruction manual and product catalog.

Refer to the Handling Precautions of End unit for assembling and installing devices, and the Handling Precautions of Power supply unit for wiring power supply.

CAUTION

- Thoroughly read and understand the instruction manual for the industrial network communication system used before using the device unit.
- Do not leave the USB port open.
- Fully understand the contents of other units connected to this product before use.
- For details on the entire remote IO system including this product, refer to the "Remote I/O RT Series Instruction Manual: System Construction".
- If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

Accessories | QR label, tie rod (2 pieces)


1 Specifications

Always use the product within its specifications.

Item	Specifications
Model No.	RT-XTEPN00N
Size (W x H x D)	mm 46.1x106x55.8
Net weight	g Approx. 230
Degree of protection	IP65 / IP67 (when connected) ^{Note 1}
Working temperature range	°C -10 to +55
Relative humidity	%RH 30 to 85
Ambient atmosphere	No corrosive gases or heavy dust
Installation location	Indoor use
Altitude	m Up to 2000
Pollution degree	3
Network communication	PROFINET IO, MRP supported: Use up to 514 bytes
Network connector	M12 (D) 4pin female x 2
Maximum number of points	Up to 4096 points (512 bytes) for input and output combined
Internal current consumption (for unit/input)	mA 100 or less
Internal current consumption (for output)	mA 20 or less
LED	For indicating device and communication status / 8 pieces
Number of I/O units that can be connected	units 17
Unit automatic recognition	Type / order recognition and monitoring
PC software:	Connect to PC via USB
Data synchronization interval between units	ms Approx. 0.5 (minimum)
Web API function	Yes


Note 1 IP65/IP67 is not part of the UL certification.

2 External dimensions

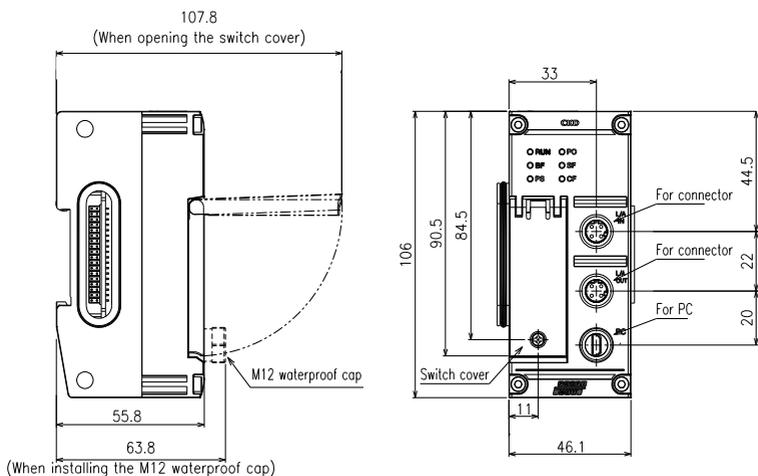

Dimensional unit: mm

3 Names and functions of each part

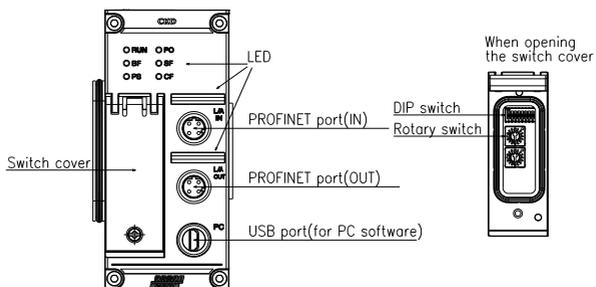

Name	Function
LED	Eight LEDs indicate the status of communication and system.
Switch cover	Protects the switch inside the unit. Tighten the screw to the specified torque (0.10 ± 0.02 N/m) after setting the switches.
PROFINET port (IN/OUT)	To be input from PROFINET controller or another device. Or outputs from the product to another device.
USB port	Connects to RTXTools, a PC software dedicated to the RT series. Download from CKD website (https://www.ckd.co.jp/kiki/jp/) (free of charge)
Dip switches	Set the operation of the product and the remote I/O system.
Rotary switches	Set the device name of the product as a PROFINET device.

4 LED indicators and switch settings

4.1 LED indicators

These LEDs indicate the status of the product and network.

Name	Status	Meaning
RUN	Green blinking	-Preparing for communication -At the time receiving the Flash LED command
	Green on	Normal condition
	Off	The power is off.
BF	Red blinking (1Hz)	-Configuration data with PLC mismatched -Process data size of each unit mismatched
	Red on	-The Device Name of the PLC's settings and device unit mismatched -The power of PLC is off. -The network cable between PLC and the device unit is not wired. -Failure of PLC or the device unit.
	Green blinking	-At the time receiving the Flash LED command
	Off	-The power is off. -Connection established and communicating normally.
L/A IN L/A OUT	Green blinking (fast)	Link, Activity
	Green on	Link, No activity
	Off	No link, No activity
PS	Red blinking (fast)	Unit/input voltage is outside the range of $24\text{ V} \pm 25\%$.
	Yellow on	Unit/input voltage restored from voltage error.
	Green on	Unit/input voltage is normal.
	Off	Power OFF status
PO	Red blinking (fast)	Output voltage is outside the range of $24\text{ V} \pm 25\%$.
	Yellow on	Output voltage restored from voltage error.
	Green on	Output voltage is normal.
	Off	Power OFF status
SF	Red blinking (fast)	Internal bus communication error
	Red blinking (slow)	Hardware error
	Red blinking (twice)	Factory setting error
	Yellow on	Operation waiting
	Yellow blinking (fast)	Unit configuration error
	Green blinking (fast)	Started with initialized set memory status.
	Green blinking (slow)	Process data overflow
	Green on	Normal condition
Off	Power OFF status	
CF	Red blinking (slow)	WebAPI/PC concurrent access
	Yellow on	Being set to the forced I/O settings
	Green blinking (fast)	Being accessed to WebAPI
	Green blinking (slow)	Being accessed from PC
	Off	Power OFF status or no access status

4.2 Switch settings

Conduct the operation settings of remote I/O system including the product and the IP address settings as an EtherNet/IP target(adapter). The setting is read into memory at power-up. Refer to the following table for the settings of each switch.

CAUTION

- Make sure to set the switches with the power off.
- Keep the cover closed and tighten the screw to the specified torque, except when setting the switches.
- Be careful not to allow any foreign object to get inside when setting the switches.
- Be careful when changing the settings, as the setting switch may be damaged.
- Never touch the internal circuit board other than switch when setting the switches.



Dip switch



Upper digit (x16)



Lower digit (x1)

Rotary switch

Dip switch (DIPSW) settings

No.	Name	Settings	Setting range
1	WebAPI	Specifies whether the WebAPI function is enabled or disabled OFF: Disable (factory setting) ON: Enable	ON/OFF
2	Reserved	Not used	OFF
3	Output settings in the event of a communication error/ priority to hardware	Selects whether the operation of all connected I/O units is specified at once by using No.4 or individually by unit. OFF: Set individually by unit (factory setting) ON: Specified all units at once (specified by dip switch 4)	ON/OFF
4	HOLD/CLEAR	Selects the output operation (Note 2) in the event of a communication error (Note 1). OFF: CLEAR (Refer to the instruction manual of each unit for details. Factory setting) ON: HELD at the last value Note 1: Refers to a communication error of industrial network or internal bus. Note 2: For units with output function.	ON/OFF
5	Parameter initialization at startup	Restores all the units to the factory setting. OFF: Will not initialize (factory setting) ON: All units will be restored to the factory setting.	ON/OFF
6	Reserved	Not used	OFF
7	Reserved	Not used	OFF
8	Remote I/O system diagnostic information ON/OFF	OFF: Does not add diagnostic information (factory setting) ON: Diagnostic information for the entire remote I/O system is added to the data transmitted to the PLC.	ON/OFF

Rotary switch settings

Name	Settings	Setting range
x16	Set the device name of the PROFINET compatible device unit. Set 0x00 to 0xff with x1 and x16 switches. 0x00: Use the setting value of a software.	0 (0x0) to 15 (0xF)
x1	0x01 to 0xFF : Set the device name to "rt-xx". (Note: "xx" is the value set by the switches.) Factory setting: 0x00(rt)	0 (0x0) to 15 (0xF)

5 Wiring

Function description and connection of the terminal are as following.

CAUTION

- An electric shock may occur by touching the electrical wiring connection (bare live part). Make sure to power off before wiring. Also, do not touch the live parts with bare hands.
- Do not apply tension or impact to the network cable. Long cables can exert unexpected momentum and impact due to its weight, and this can consequently damage the connectors and devices. Take appropriate measures; for example, secure the wiring to the machine or device midway.
- Do not wire the network cable and the power line in parallel to prevent problems caused by noise.
- Discharge static electricity that has built up on your body by touching a grounded metal object before handling the device. Static electricity may cause damage to the product.

5.1 Communication distance and wiring

Although the product accepts a standard Ethernet cable and supports flexible wiring methods, there are limits depending on the wiring material, devices, master(originator(scanner)), hub etc. Always understand their specifications thoroughly before wiring. (For details, refer to the instruction manual issued by the originator(scanner) manufacturer and the ODVA's specification relates to wiring.)

5.2 Unit/input power supply and output power supply

The power supply from the power supply unit (RT-XP24A01N) operates the product. The power supply unit that supplies power to the product needs to be located on the left side of the product. For details, refer to the "Remote I/O RT Series Instruction Manual: System Construction".

5.3 Connecting and wiring to EtherNet/IP port (M12 connector)

The network plug is not supplied with the product. Separately purchase a network plug that satisfies the specifications. Wiring the network cable to the network plug enables the plug to connect to the network connector socket on the product.

Refer to the following network connector pin arrangement and wiring example of network cable for the wiring. Use a network cable of CAT5 or higher.

Recommended network cable with connector M12-RJ45

- XS5W-T421-□MC-K (M12 straight)
- 0945 700 50□□ (M12 straight)

Mfd by Omron Corporation
Mfd by HARTING K.K.

Recommended network plug and network cable


- 0945 600 01□□ (cable only)
- 2103 281 1405 (assembly type M12 connector)
- 0945 151 1100 (assembly type RJ-45 connector)

Mfd by HARTING K.K.
Mfd by HARTING K.K.
Mfd by HARTING K.K.

Follow the steps below to connect the network cable to the network plug.

<Network cable>

- (1) After confirming safety, stop network communication and turn off all peripheral equipment.
- (2) Refer to the figure below and connect the EtherNet/IP compliant cable to M12 connector.

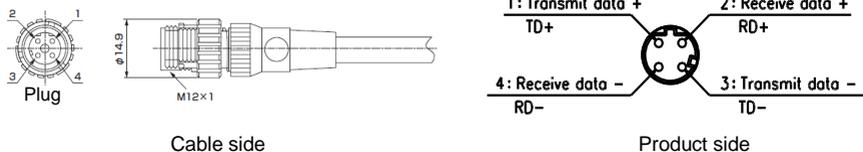

Port	Pin	Signal	Function
IN/ OUT	1	TD+	Transmission data, plus
	2	RD+	Reception data, plus
	3	TD-	Transmission data, minus
	4	RD-	Reception data, minus

! CAUTION

- Use a dedicated network cable that complies with EtherNet/IP specifications.
- Provide sufficient bending radius for the network cable and do not bend it forcibly.

6 Maintenance

Refer to the "Remote I/O RT Series Instruction Manual: System Construction" for installing and removing the product(device).

! CAUTION

- Do not remove the device by pulling cable or connector that may cause disconnection or damage.
- Touching the electrical wiring (bare live part) or the connector connected between units may cause an electric shock or malfunction.
- Do not install the unit with dirt or dust on the unit opening, gasket, O-ring, etc.

7 Settings by GSDML files

In order for a PROFINET device to participate in the network, it is necessary to register the device to the PROFINET controller using the GSDML file that describes the communication specifications of the device. For the registration, refer to the instruction manual of the PROFINET controller. Use the latest GSDML file for a suitable network configuration.

7.1 Registering the device

The registration procedure may differ depending on the type, number of connected units, and diagnostic information ON/OFF.

Check the connected units and dip switch settings before starting work.

7.2 Size and allocation of process data

When connecting the product and an EtherNet/IP originator(scanner), it is necessary to specify the input and output process data sizes. Use the table below to calculate the size, or check the I/O memory tab in RTXTools^{Note1}. RTXTools is used by connecting the PC and the product via LAN or USB.

Note1: PC software dedicated to RT series. Download from CKD website (<https://www.ckd.co.jp/kiki/jp/>) (free of charge)

Model No.	Name	Input (byte)	Output (byte)	Remarks
RT-XTEPN00N	Device unit	0(2)	0	Input 2 byte when dip switch No. 8 is ON
RT-XADGA16A/B	Digital input unit (M12)	2	0	
RT-XADGA08A/B	Digital input unit (M8)	1	0	
RT-XADGC32A/B	Digital input unit (Push-in terminal block)	4	0	
RT-XBDGA16A/B	Digital output unit (M12)	0	2	
RT-XBDGC32A/B	Digital output unit (Push-in terminal block)	0	4	
RT-XAAGA02N	Analog input unit	4	0	
RT-XBAGA02N	Analog output unit	0	4	
RT-XVVCN32A/B	Valve I/F unit	0	4	
RT-XLMSA08N	IO-Link master unit	6 to 64	2 to 64	Variable depending on settings

8 Acyclic communication

The product supports the following acyclic communication. Refer to the instruction manual for the details.

Index	名称	説明
0x0010	Manifold Diagnosis	Diagnosis of whole system
0x0020 to 0x0032	Unit Diagnosis	Diagnosis of a unit. The index is what adding the target unit's position number to 0x0020.
0x0040 to 0x0052	Points CH Port Diagnosis	Diagnosis of CH/point/port The index is what adding the target unit's position number to 0x0040.
0x0060 to 0x0072	Specific Diagnosis	Diagnosis specific to a unit The index is what adding the target unit's position number to 0x0140.
0x01A0	Detected Module Ident List	List of the unit ID detected at startup.
0x0200 to 0x02FE	Diagnosis History	Diagnosis log Up to 255 logs starting with the Index: 0x0200.
0x0400 to 0x0412	Unit Parameters	Unit settings The index is what adding the target unit's position number to 0x0400.
0x0460 to 0x0472	IO-Link Master ISDU Write	ISDU communication (Write) The index is what adding the target unit's position number to 0x0460.
0x0480 to 0x0492	IO-Link Master ISDU Read	ISDU communication (Read) The index is what adding the target unit's position number to 0x0480.
0x0600 to 0x0612	Process Data	Process data of the target unit The index is what adding the target unit's position number to 0x0600.

9 WebAPI

When starting the product while the dip switch No.1 is ON, the WebAPI function will be enabled. It supports to obtain the status and settings of the product and set the operation via LAN if the WebAPI function is enabled. WebAPI can be accessed from RTXTools and applications that can communicate with HTTP. Refer to the instruction manual for the details.

PRECAUTIONS

- For the delay time, refer to the instruction manual for the EtherNet/IP originator(scanner).
Transmission delay as a system varies depending on the PLC scan time and other devices connected to the same network.
- Make sure that cables and connectors are securely connected before turning on the power.
- Do not disassemble, modify, or repair the product as that may cause failure or malfunction.
- Do not drop or apply excessive vibrations or shocks to the product as the part inside are made precisely.
- Do not attach or detach the connector while the power is ON as that may cause a failure or malfunction.
- Mold and rust may develop on the product if it is exposed to high humidity during transportation. Include moisture absorbers and tightly seal the package.

For inquiries regarding the product, please contact the following or the nearest sales office.

CKD Corporation

Head Office and Plant

250, Uji 2-chome, Komaki, Aichi, 485-8551, Japan

Phone: +81-(0)568-77-1111 /Fax: +81-(0)568-77-1123

Overseas Sales Dept.

250, Uji 2-chome, Komaki, Aichi, 485-8551, Japan

Phone: +81-(0)568-74-1338 /Fax: +81-(0)568-74-1165

Please check global distributors with our catalog or the website below.

<https://www.ckd.co.jp/en/>